



IX.br - Relatório de Incidente/Incident Report	Localidade/City: São Paulo
Início/Begin: 05/08/2018 17:12 GMT-03	Término/Finish: 05/08/2018 17:19 GMT-03
Descrição: Às 17:20 GMT-03 ocorreu uma queda de um dos barramentos de energia DC no PIX Eletronet que provocou o desligamento de um equipamento de rede e do transporte óptico devido a alguma falha no sistema de alimentação redundante. Esta queda provocou uma instabilidade geral na rede entre 17:12 e 17:19 GMT-03.	
Ação Corretiva: Estamos investigando a causa raiz do problema para definirmos a ação corretiva a ser adotada. Prazo para execução: 3 dias.	
Description: At 17:20 GMT-03 there was a drop in one of the DC power buses on the PIX Eletronet which caused the shutdown of a network equipment and optical transport due to some failure in the redundant power system. This drop caused a general instability in the network between 17:12 and 17:19 GMT-03.	
Corrective Actions: We are investigating the root cause of the problem in order to define the corrective action to be taken. Deadline for execution: 3 days.	

Imagens/Imagens:

PIX Eletronet

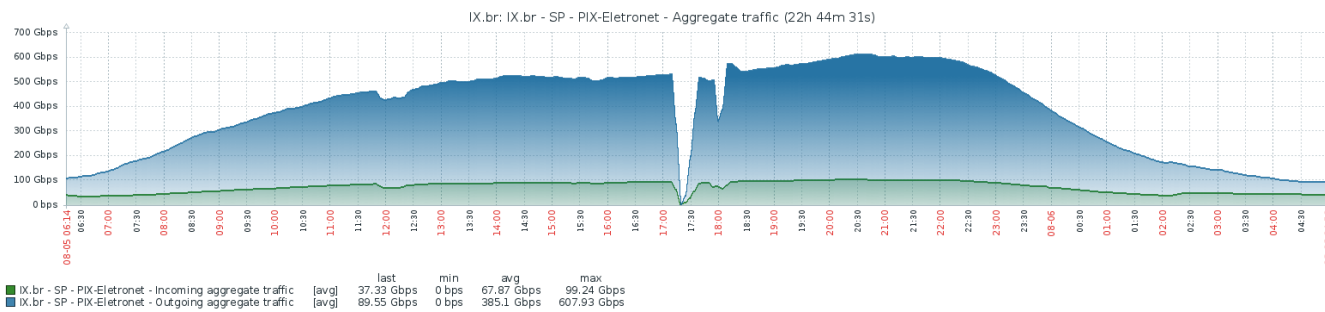

PIX Equinix-SP4

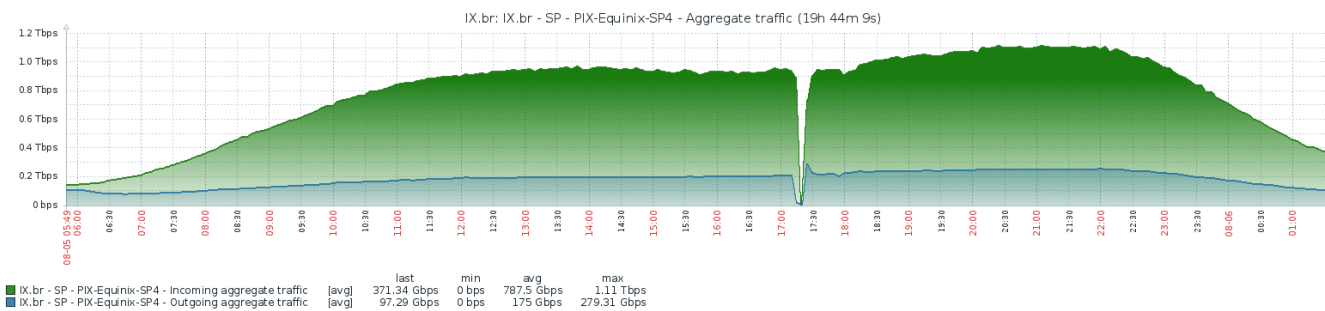

Comunicação entre PIXs / Communication between PIXs

